


Planning recommendation, air recirculation


(A)

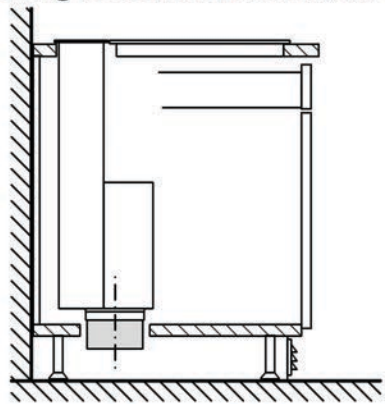

A: Exterior wall – U-value $\leq 0.5 \text{ W}/(\text{m}^2\text{K})$

Standard installation: Partially laid around the toe kick

(B)

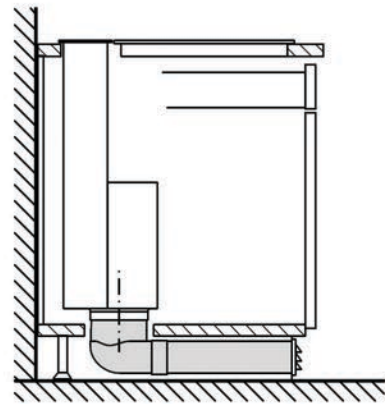

B: Exterior wall – U-value $> 0.5 \text{ W}/(\text{m}^2\text{K})$

Installation with fully laid pipework to the toe kick for poorly insulated exterior walls or above cold floors